



TYPICAL SITE PLAN

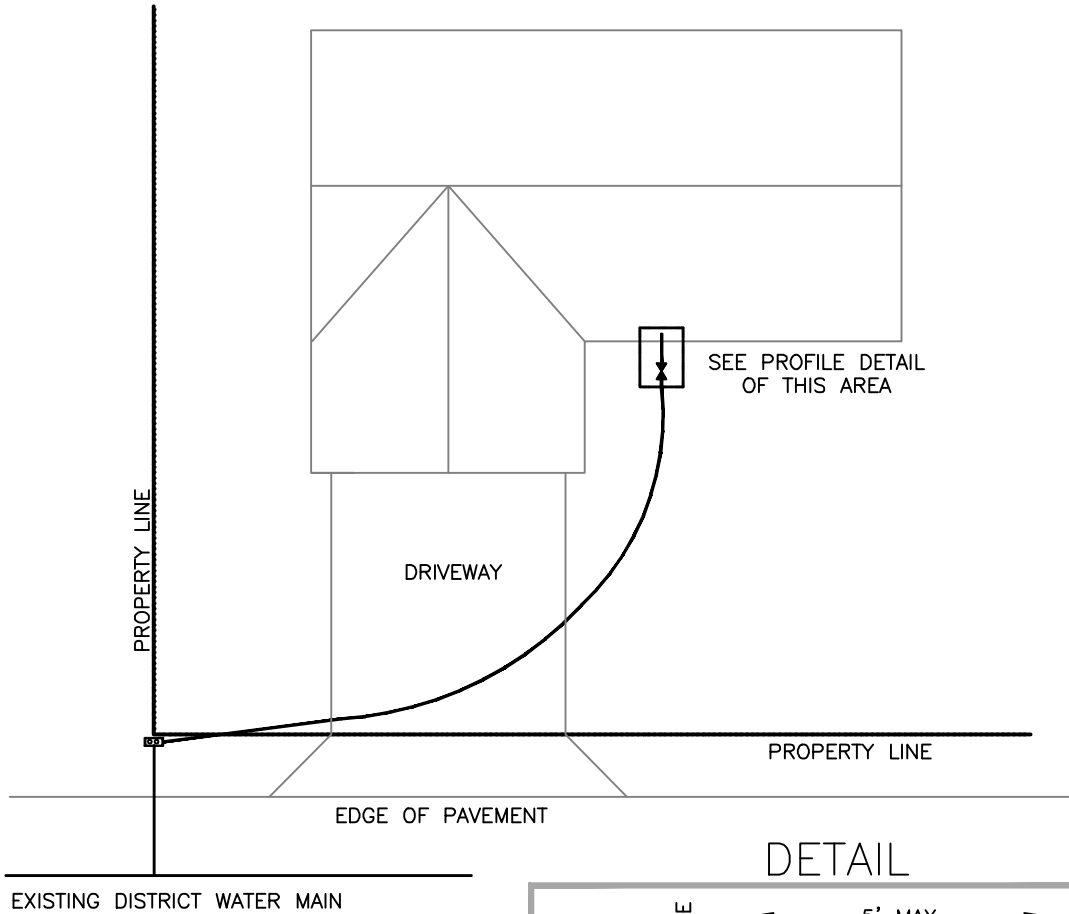

DETAIL

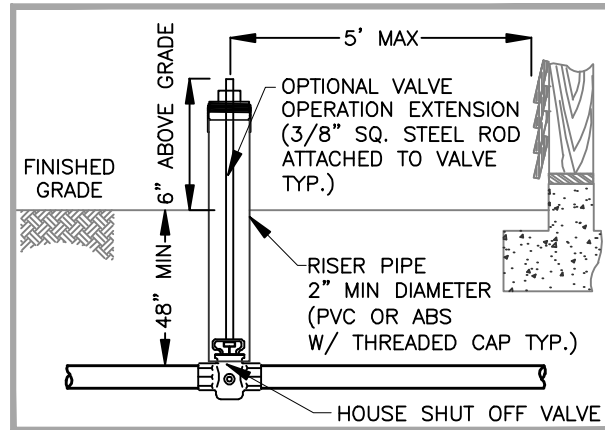

NOTES:

- 1) SHUT OFF VALVE OUTSIDE THE FOUNDATION IN AN ALWAYS ACCESSIBLE LOCATION.
- 2) VALVE MUST BE CONSTRUCTED OF BRASS WITH NON-CORROSIVE WORKING PARTS.
- 3) VALVE MUST HAVE ONE QUARTER (1/4) TURN ON/OFF CAPABILITY.

HOUSE SHUT OFF VALVE:
3/4" TO 2"



NO SCALE

WATER SHUT OFF AND ABANDONMENT DETAILS



SOUTH TAHOE PUBLIC UTILITY DISTRICT

Sewer - 1800 • Water
1278 Meadow Crest Drive • South Lake Tahoe, California 96160
Phone (800) 644-6474 Fax (800) 641-4310
www.stpu.d.net

DATE: JAN 2008
DRAWN BY: [illegible]
CHECKED BY: [illegible]
SCALE: [illegible]
SHEET NO: 022
OF 73 SHEETS