



## PLAN VIEW

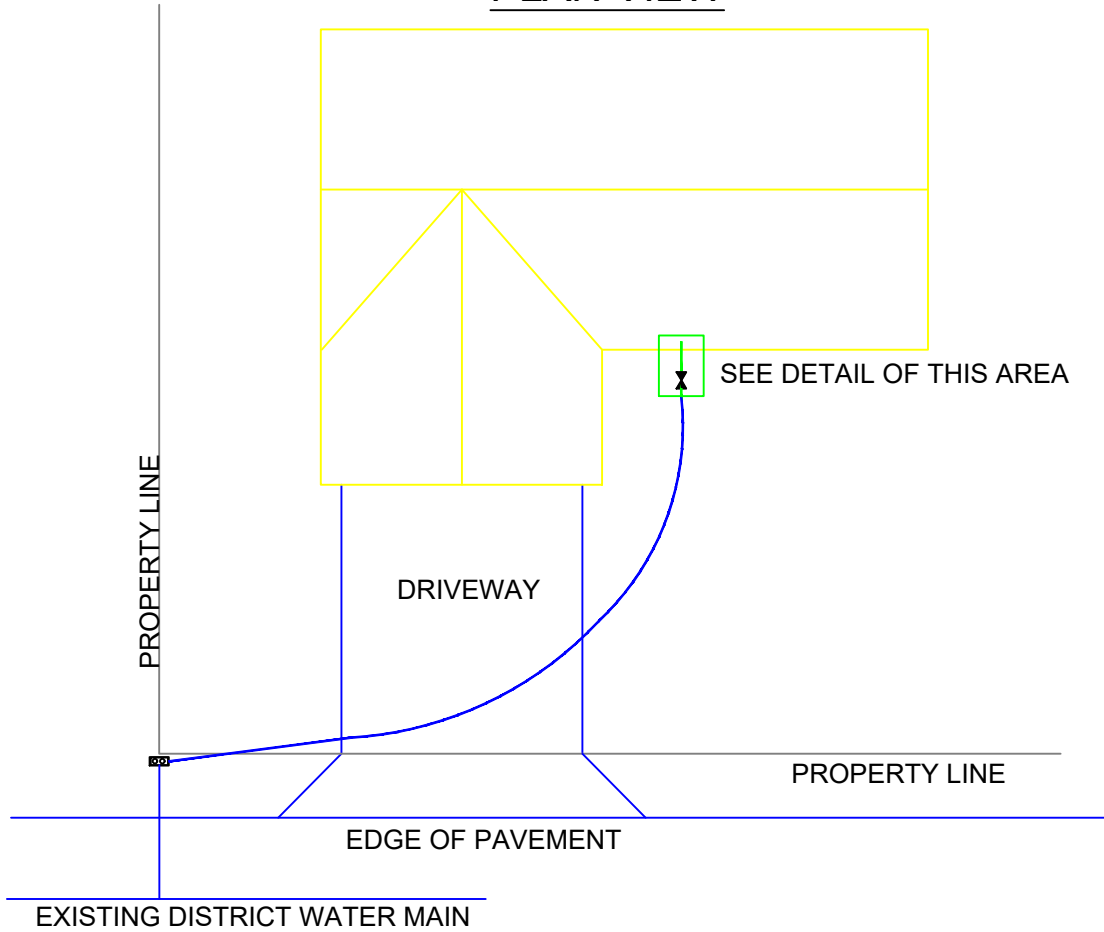

## DETAIL

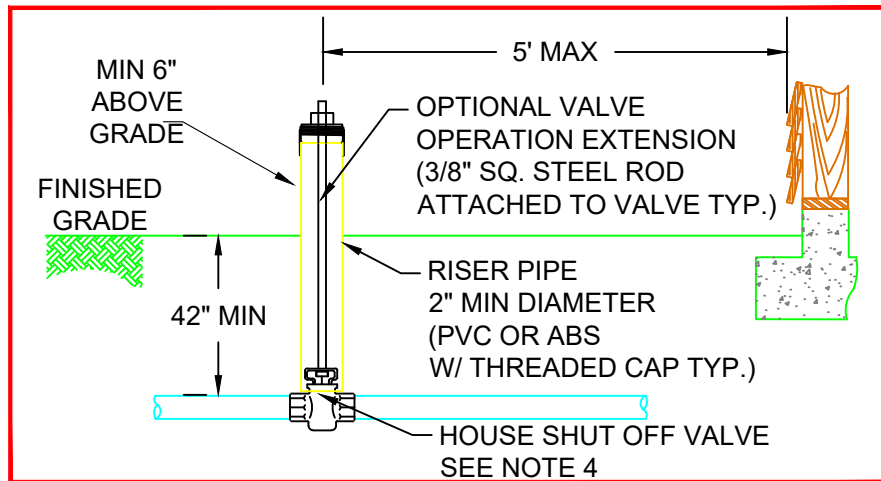

**NOTES:**

- 1) SHUT OFF VALVE OUTSIDE THE FOUNDATION IN AN ALWAYS ACCESSIBLE LOCATION.
- 2) VALVE MUST BE CONSTRUCTED OF BRASS WITH NON-CORROSIVE WORKING PARTS.
- 3) VALVE MUST HAVE ONE QUARTER (1/4) TURN ON/OFF CAPABILITY.
- 4) STOP AND WASTE VALVES ARE NOT PERMITTED FOR BURIED APPLICATIONS PER UPC 603.5.17

APPROVED BY:

*Megan Colvey*

MEGAN COLVEY, DISTRICT ENGINEER  
P.E. NO. C74708

## BUILDING WATER SHUTOFF VALVE 3/4" TO 2"

STANDARD DETAIL PC01

DATE: 01/12/2025

SCALE: NTS



PC01