



PLAN VIEW

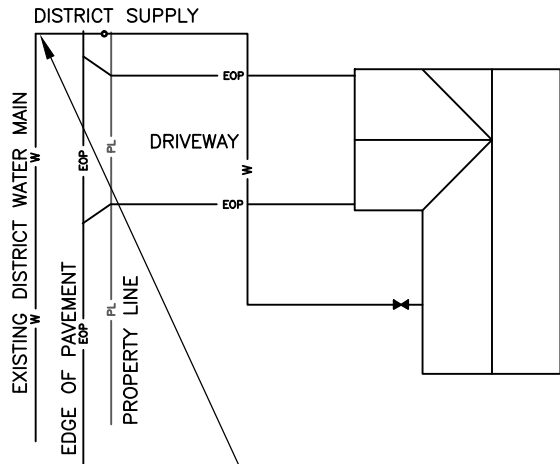

POINT OF WATER CAP OFF WILL BE MAIN LINE VALVE (SEE DETAIL) OR CONNECTION TO MAIN LINE IF NO VALVE

DETAIL

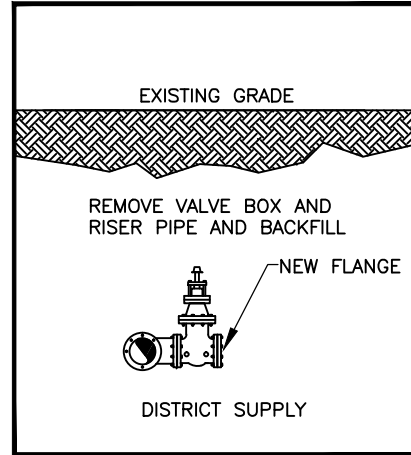

NOTES:

- 1) UNDERGROUND SERVICE ALERT (USA) 811 TO BE NOTIFIED A MINIMUM OF 48 HOURS BEFORE ANY EXCAVATION.
- 2) ALL WATER SERVICE(S) TO BE CAPPED SHALL BE FIELD LOCATED BY DISTRICT INSPECTORS.
- 3) DO NOT DEMOLISH ANY BUILDING UNTIL WATER SERVICE CAP OFF LOCATION FOR THAT BUILDING IS EXCAVATED AND CONFIRMED.
- 4) WATER SERVICE(S) WILL BE CAPPED AT THE MAIN LINE VALVE OR CONNECTION TO MAIN LINE IF NO VALVE. FINAL CAP OFF LOCATION SHALL BE FIELD VERIFIED AND APPROVED BY THE DISTRICT.
- 5) WATER SERVICE(S) MUST BE SEVERED AT THE CAP OFF POINT IN A WORKMANSHIP LIKE MANNER APPROPRIATE FOR THE TYPE OF PIPE TO BE CAPPED. A MINIMUM OF SIX FEET (6') OF PIPING DOWNSTREAM OF THE CAP OFF POINT SHALL BE REMOVED.
- 6) THE PLUGGING OF THE SEVERED WATER SERVICE(S) MUST BE MADE WITH A NEW IRON FLANGE AND GASKET APPROPRIATE FOR THAT SIZE WATER SERVICE.
- 7) NO WORK SHALL BE COVERED UNTIL INSPECTED AND APPROVED BY THE DISTRICT.
- 8) THE DISTRICT SHALL BE GIVEN A MINIMUM OF TWENTY FOUR (24) HOURS NOTICE TO INSPECT ALL WORK ASSOCIATED WITH CAPPING OF LATERAL(S).

ABANDON WATER SERVICE 3" TO 12"



NO SCALE

FILE: STANDARDS	DATE: JUL 2016
SHEET: S4-D3	SCALE: NO SCALE
	DRAWN: MAM

WATER SHUT OFF & ABANDONMENT DETAILS



SOUTH TAHOE PUBLIC UTILITY DISTRICT

Sewer . 1950 . Water A PUBLIC AGENCY
1275 Meadow Crest Drive South Lake Tahoe, California 96150
Phone (530) 544-6474 Fax (530) 541-4319
WWW.STPUD.US